

EVERY EFFORT HAS BEEN MADE TO INSURE THE ACCURACY OF THESE DRAWINGS. HOWEVER, THE CONTRACTOR SHALL CHECK & VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION.


ALL IDEAS, DESIGNS, ARRANGMENTS, DRAWINGS & PLANS SET FORTH ON THIS SHEET ARE THE ORIGINAL WORK, PRODUCT OF, OWNED BY, AND ARE THE PROPERTY OF ITS RESPECTIVE OWNER(S).

502 N MULLAN RD
 SPOKANE VALLEY, WA 99206
 PHONE: (509) 362-2214
 www.spokanehouseplans.com


SPOKANE HOUSE PLANS INC

CONTENTS
 EXTERIOR ELEVATIONS
 ROOF PLAN
 1988 SQ FT RANCHER

DRAWN BY: AK
 DATE: 03/20/18
 SCALE: AS NOTED
 JOB NO: 1988-R
 SHEET 1
 OF 5 SHEETS

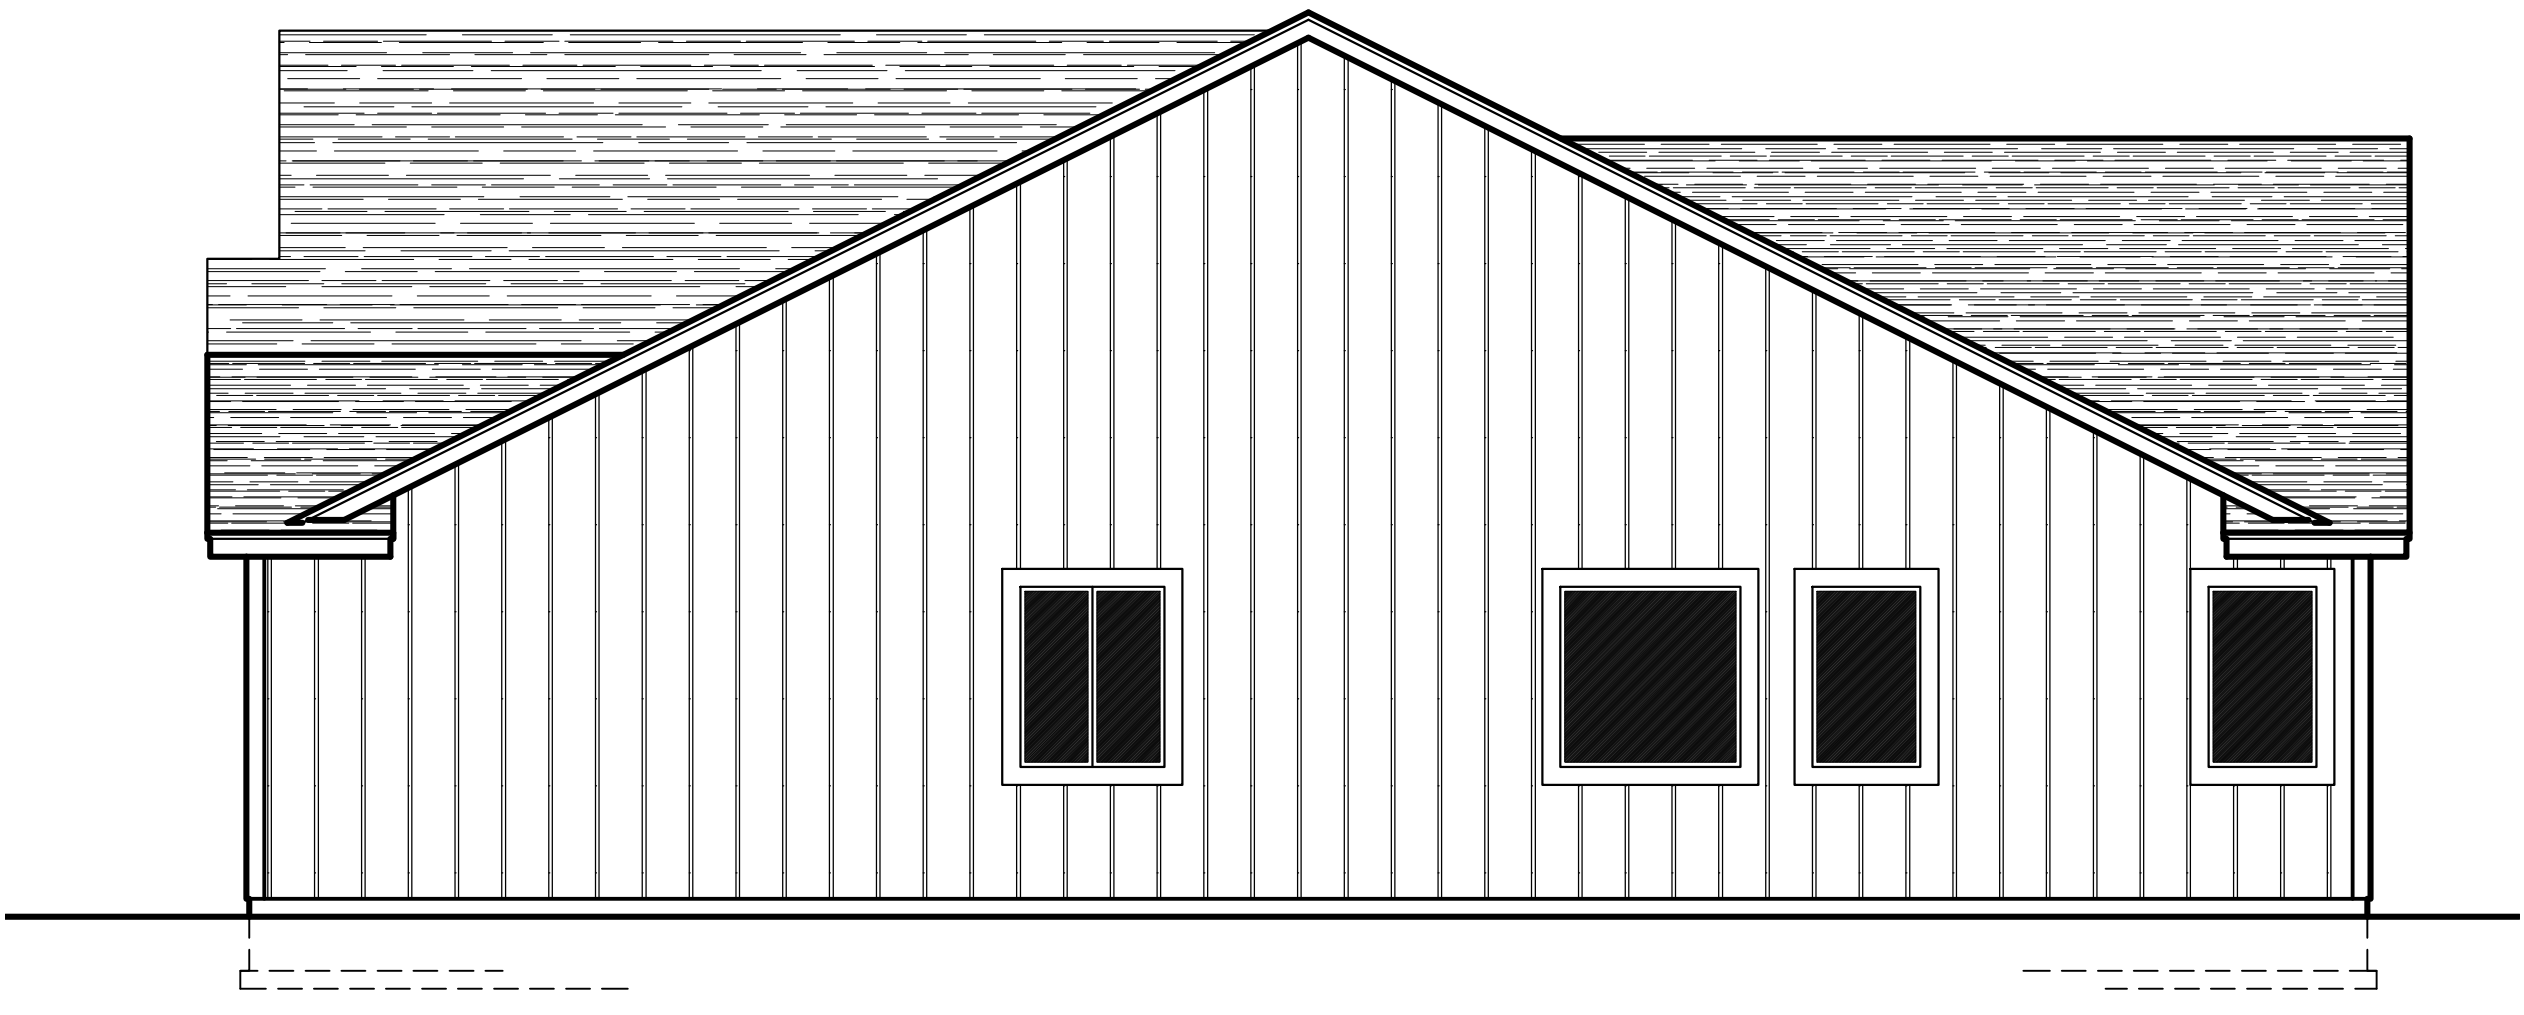


LEFT ELEVATION
 SCALE: 3/16"=1'-0"

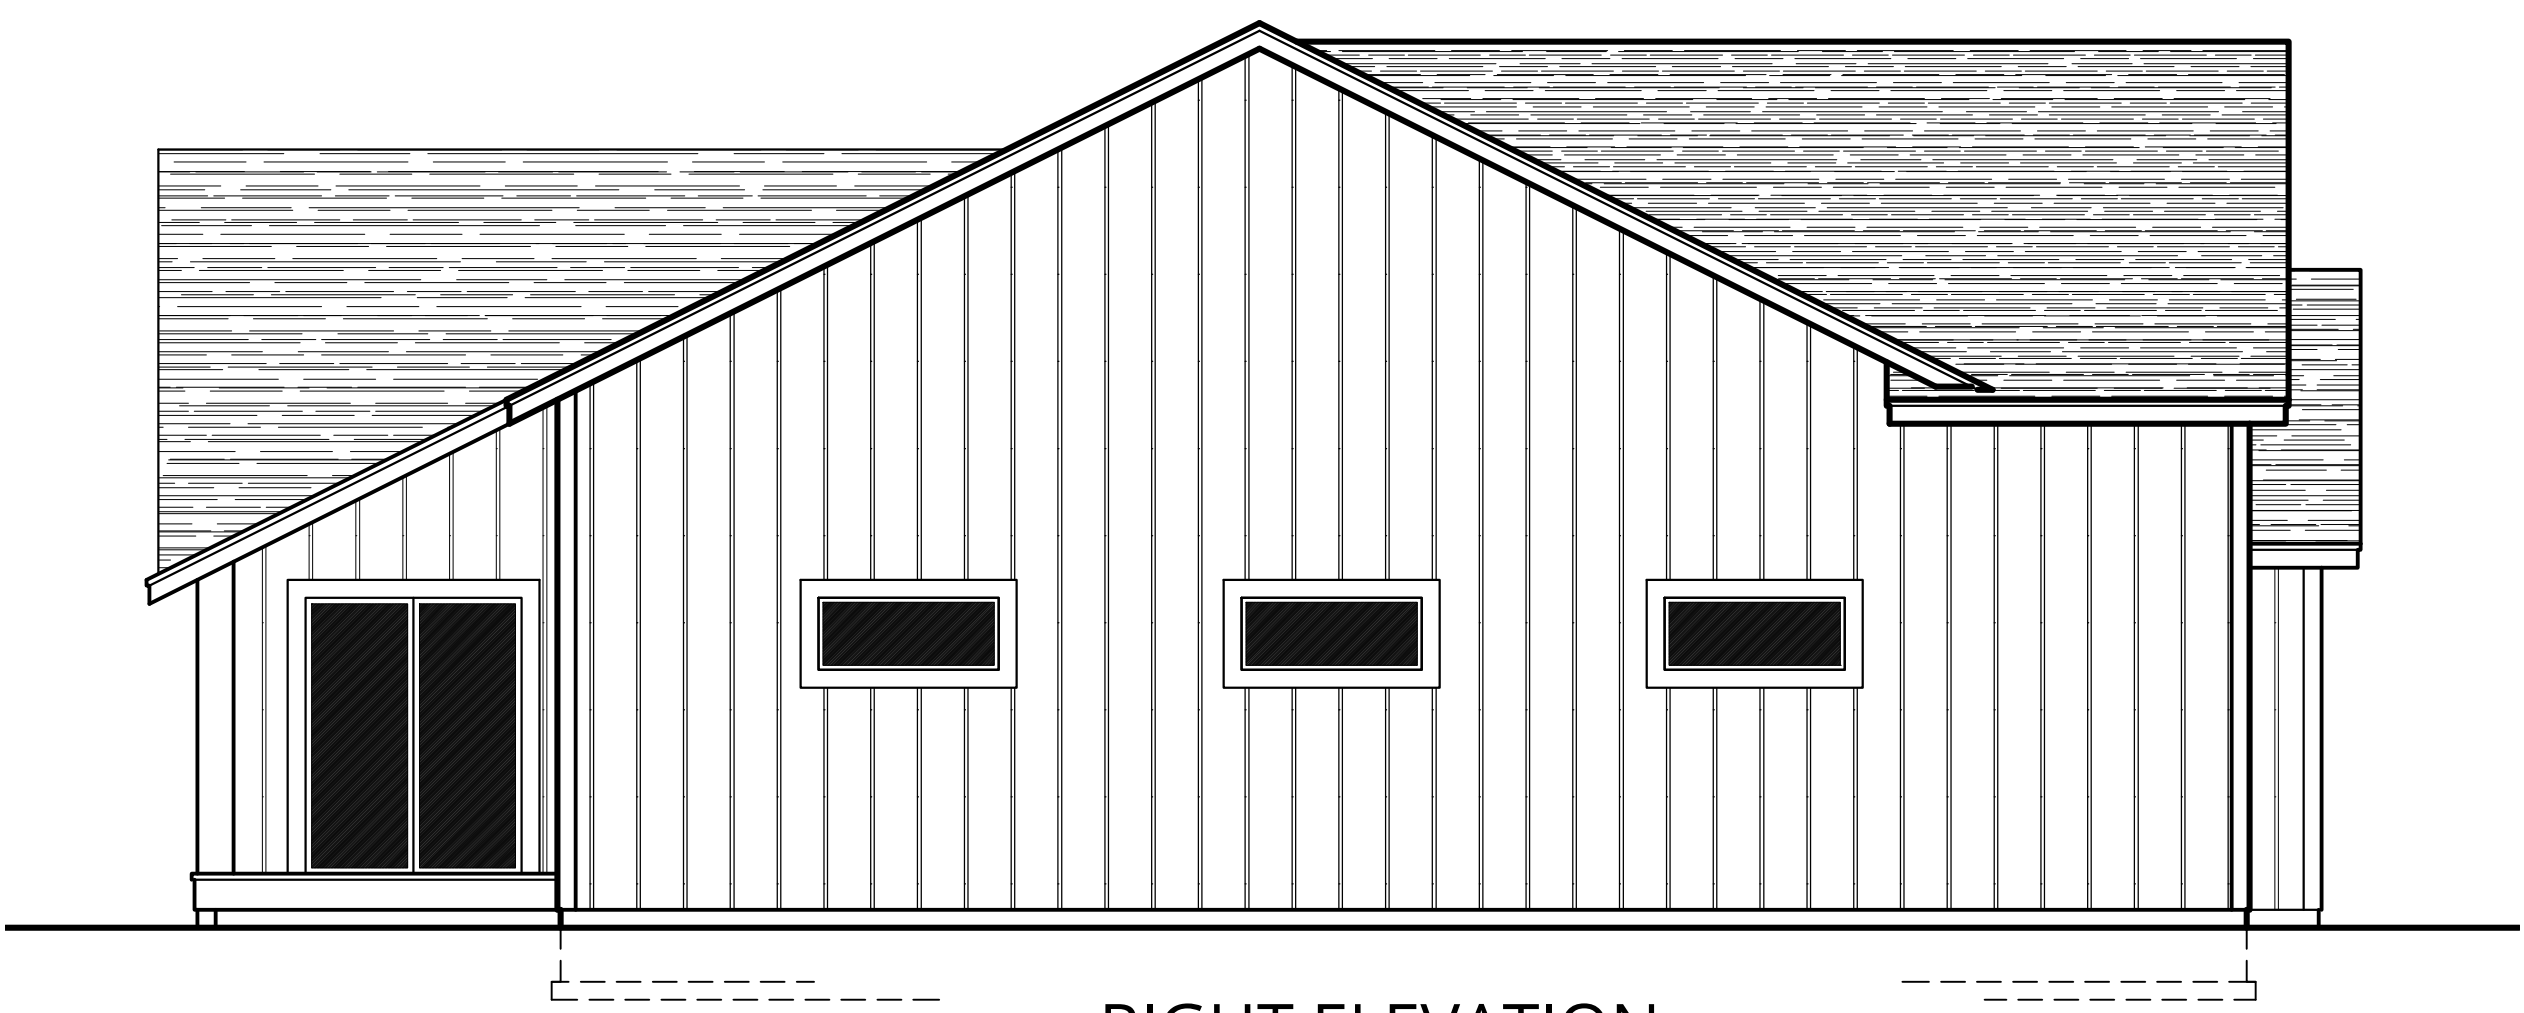

RIGHT ELEVATION
 SCALE: 3/16"=1'-0"



REAR ELEVATION
 SCALE: 3/16"=1'-0"

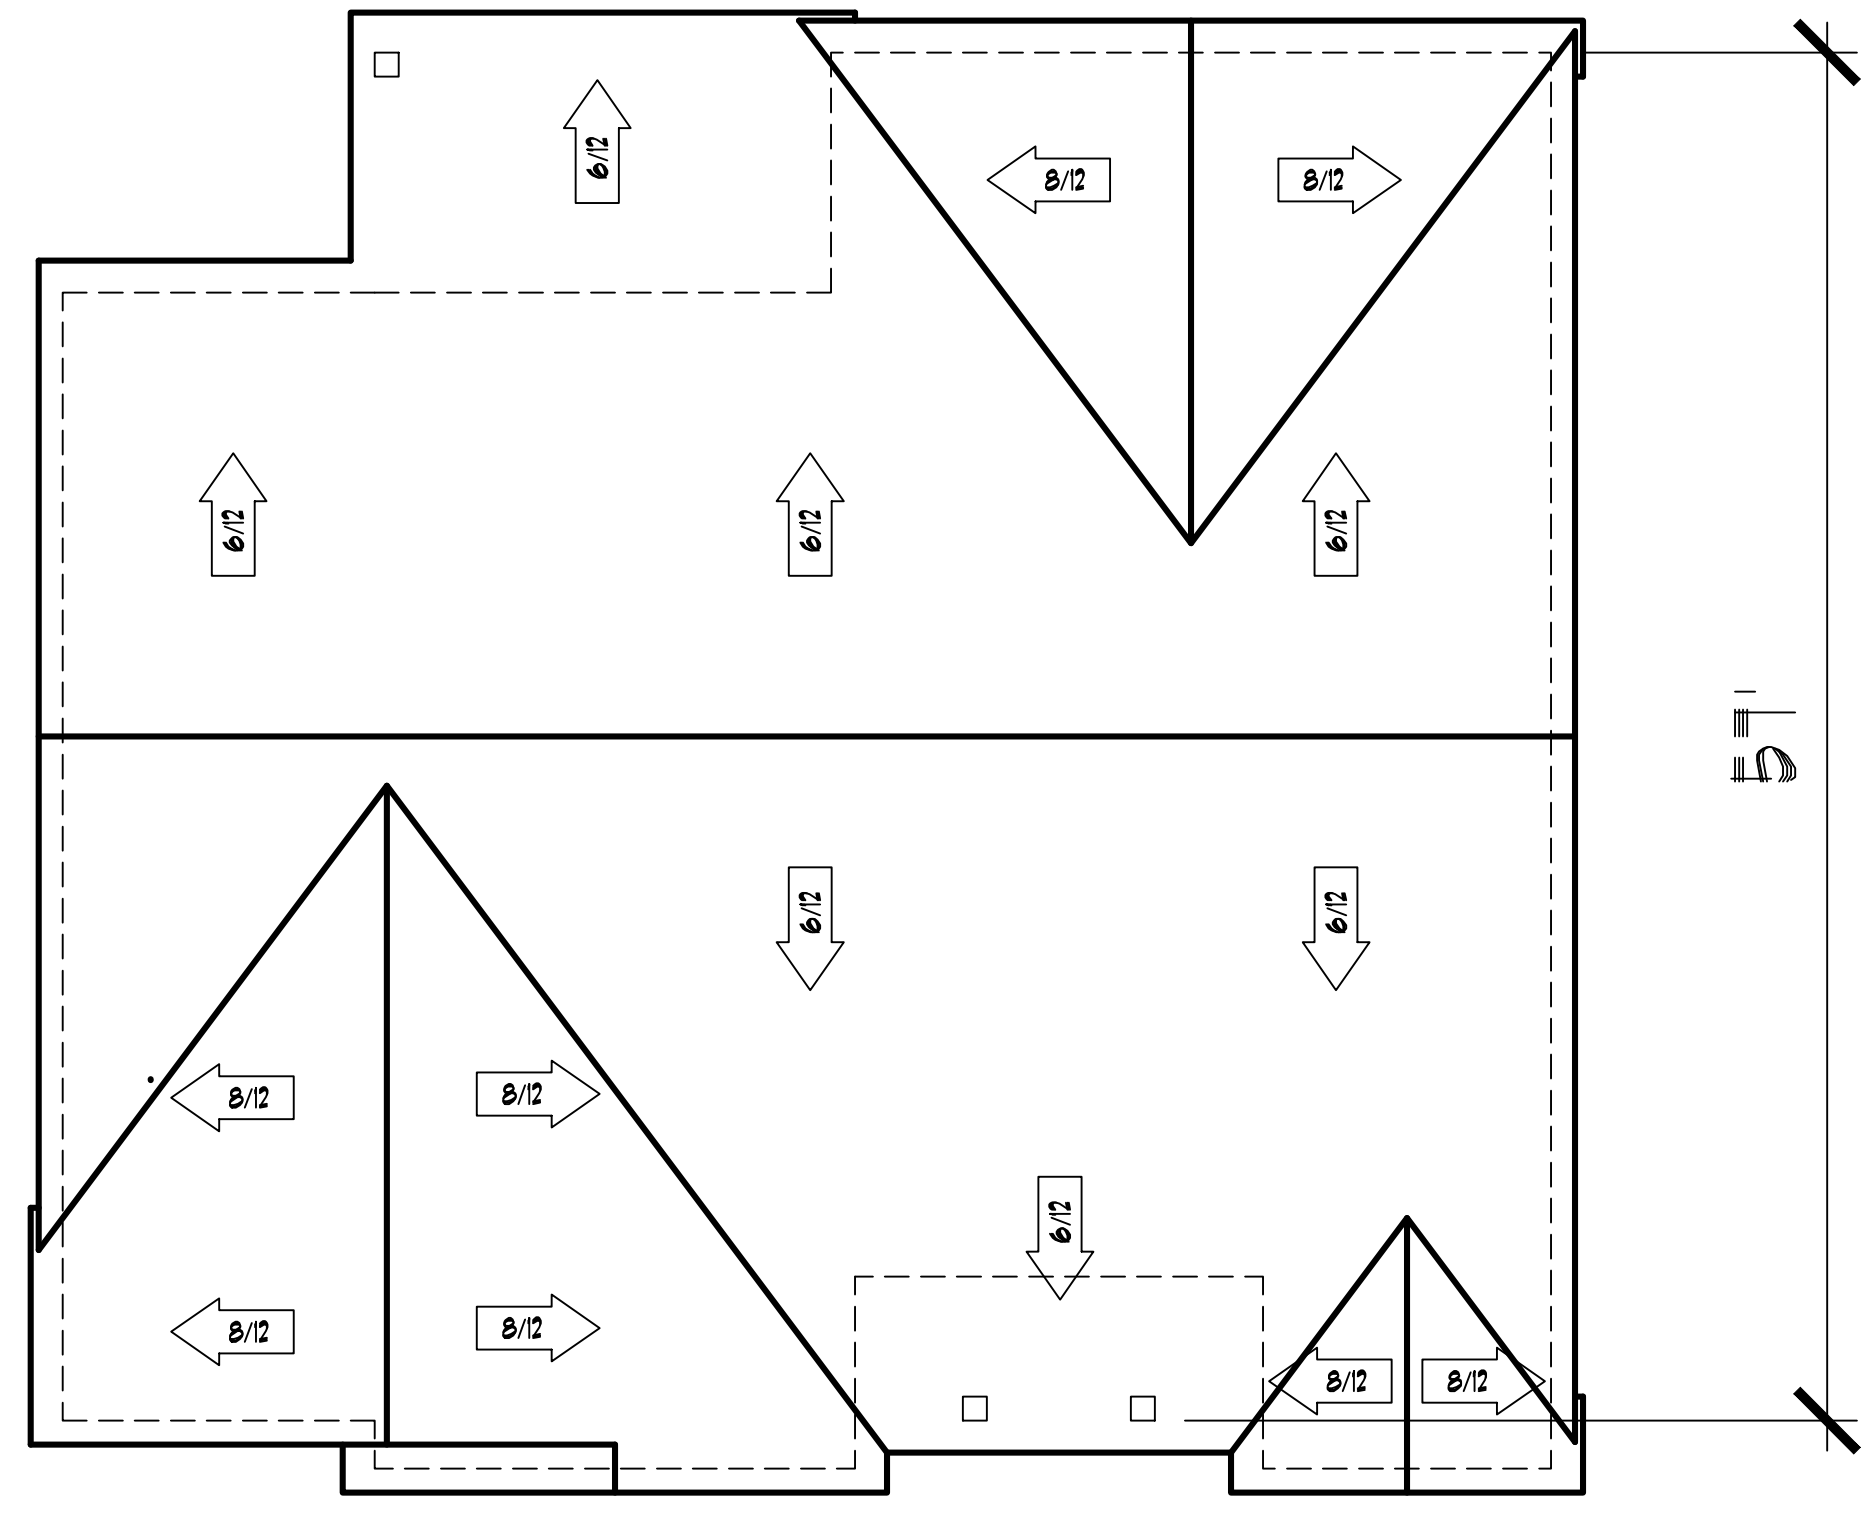

NOTES: ROOF SLOPE - AS NOTED, TYP.
 ROOF OVERHANG - 16" AT EAVES, 12" AT GABLES, TYP.
 ROOF VENTILATION - AREA / 300 SQ FT

ROOF PLAN
 SCALE: 1/8"=1'-0"



FRONT ELEVATION
 SCALE: 1/4"=1'-0"

- COMPOSITION ROOFING
- 1x8 FASCIA BD
- TOP PLATE
- BOARD-N-BATTEN SIDING
- TRIM CORNERS AND OPENINGS
- MAIN FLOOR
- FINISH GRADE
- KEEP BOTTOM OF FTG BELOW FROST LINE

INDEX OF DRAWINGS:
 1. EXTERIOR ELEVATIONS, ROOF PLAN
 2. MAIN FLOOR PLAN
 3. FOUNDATION PLAN
 4. TYPICAL DETAILS, BUILDING SECTION
 5. NOTES AND SPECIFICATIONS

WALL BRACING NOTES

Continuous Sheathing Method - 2015 IRC Section 602.10.4.2
Length requirements for Continuously Sheathed Wood Structural Panel (CS-WSP)

Adjacent clear opening height to braced panel	Min. Length of Braced Wall Panel				
	8'	9'	10'	11'	12'
64"	24"	27"	30"	33"	36"
68"	26"	27"	30"	33"	36"
72"	27"	27"	30"	33"	36"
76"	30"	29"	30"	33"	36"
80"	32"	30"	30"	33"	36"
84"	35"	32"	32"	33"	36"
88"	38"	35"	33"	33"	36"
92"	43"	37"	35"	35"	36"
96"	48"	41"	38"	36"	36"

For openings greater than 96" refer to Table R602.10.5

1. Exterior braced wall panel shall begin within 10 feet from each end of a braced wall line. The distance between adjacent edges of braced wall panels along a braced wall line shall be no greater than 20 feet.

Braced wall lines shall be continuously sheathed with 7/16" APA RATED SHEATHING 24/16, exposure 1, as a continuously sheathed wall.

Panel edge nailing is 8d Common (2.5" x 0.131") @ 6" o.c. Panel interior or field nailing is 8d Common (2.5" x 0.131") @ 12" o.c. Edge blocking is required at braced wall panels only.

2. Stagger top plate splices by 2'-0" min. and nail splice with 16d @ 3".

3. Anchor bolts should be installed within 12" of the end of a wall or the end of a plate at a splice. Anchor bolt min. embedment is 7".

4. Install floor and roof sheathing with face grain perpendicular to supports with long edges continuous over 2 or more supports and short edges staggered.

Roof sheathing shall be 7/16" APA RATED SHEATHING 24/16, exposure 1. Nail with 8d @ 6" at panel edges and 8d @ 12" at field.

Floor sheathing shall be 3/4" T&G APA STURD-I-FLOOR 24 O.C. or equal. Glue and nail with 8d ring or screw shank @ 6" at panel edges and 8d @ 12" at field.

5. Interior braced walls to be gypsum board with minimum 1/2" thickness placed on studs spaced a maximum of 24" o.c. and fastened at 7" o.c. with gypsum board nails, 0.086" in diameter, 1-5/8" long, 9/32" head.

6. For alternate braced walls refer to details provided on plans.

HEADERS


1. All headers supporting roof and ceiling to be (2)- 2x10 minimum for max. span of 6'1" with 2 jack studs, unless otherwise noted on plan.

2. Headers supporting roof, ceiling & center bearing floor to be (3)- 2x10 minimum for max. span of 6'7" with 2 jack studs, unless otherwise noted on plan.

3. All headers supporting roof, ceiling, and two center bearing floors shall be (3)- 2x10 minimum for max. span of 5'7" with 2 jack studs, unless otherwise noted on plan.

4. To reduce sizes for particular openings, refer to plan or to 2015 IRC table R602.7(1).

5. For all interior header sizes & locations, refer to plan.

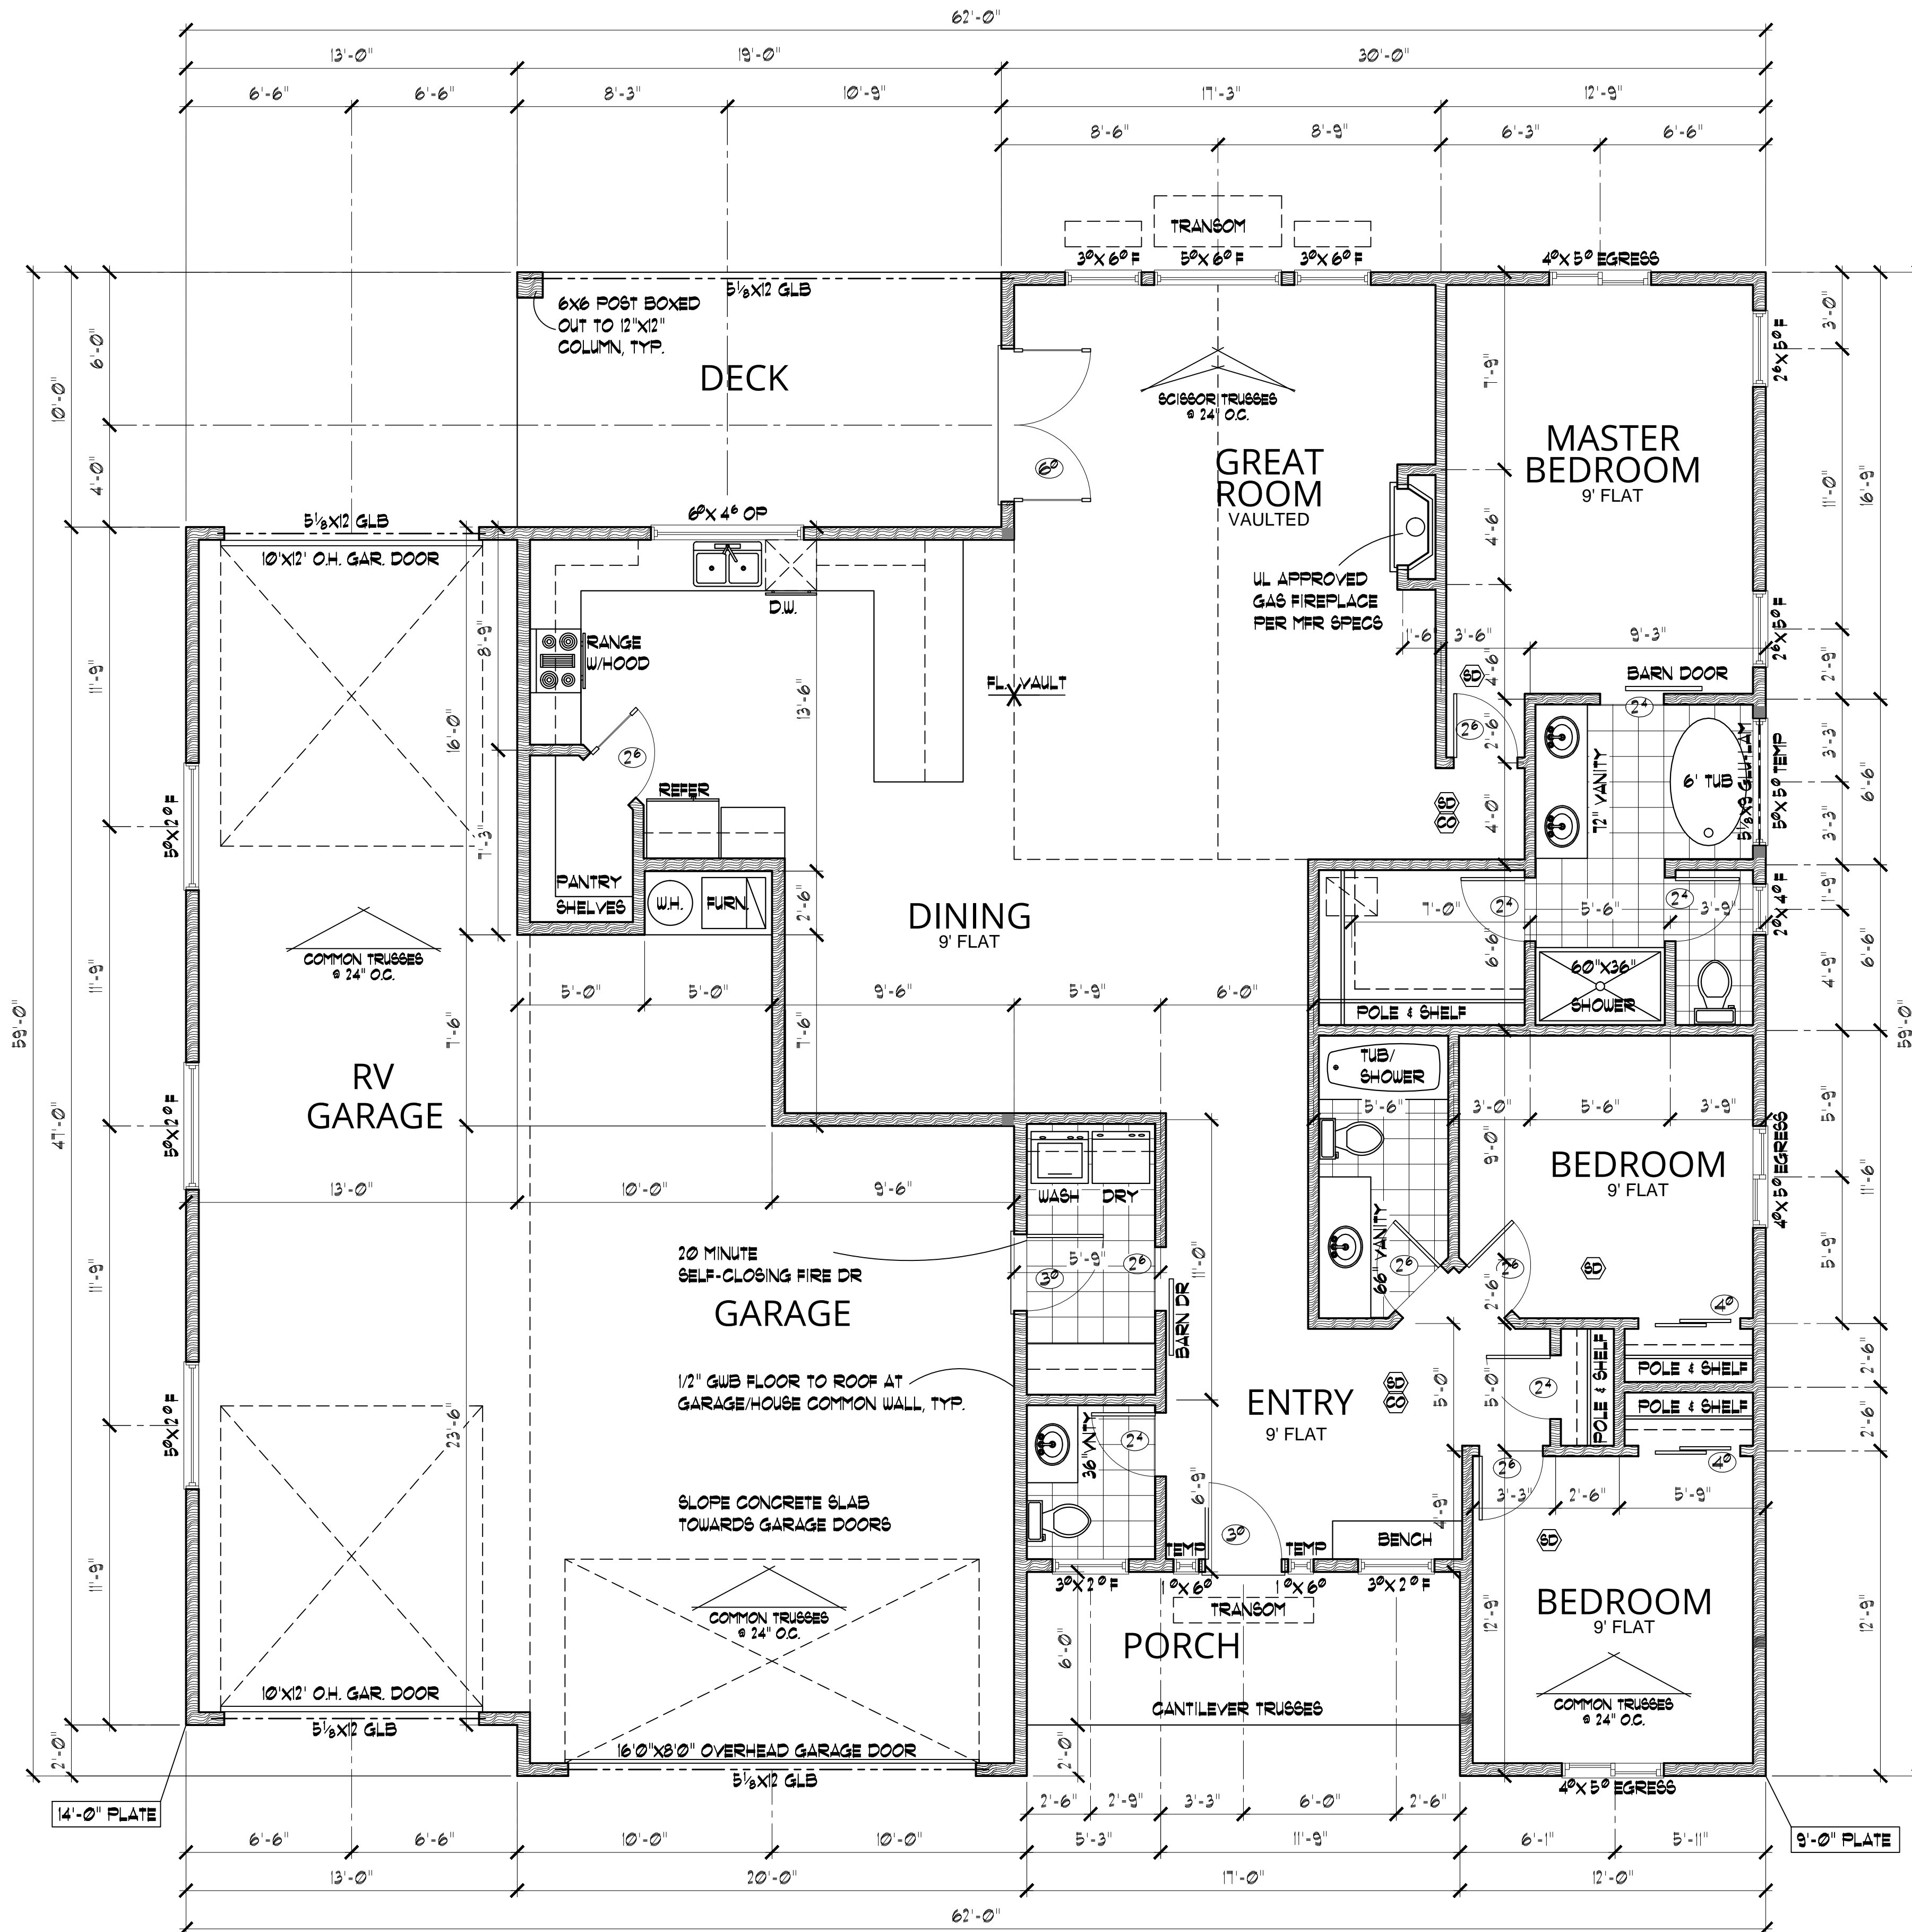

MAIN FLOOR PLAN

SCALE: 1/4"=1'-0"

NOTE:

ALL ANGLES ARE 45° UNLESS OTHERWISE NOTED

ALL WINDOWS @ HEADER HEIGHT OF 7'-8" A.F.F. UNLESS THERE IS TRANSOM(S)

EVERY EFFORT HAS BEEN MADE TO INSURE THE ACCURACY OF THESE DRAWINGS, HOWEVER, THE CONTRACTOR SHALL CHECK & VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION.

ALL IDEAS, DESIGNS, ARRANGEMENTS, DRAWINGS & PLANS SET FORTH ON THIS SHEET ARE THE ORIGINAL WORK, PRODUCT OF, OWNED BY, AND ARE THE PROPERTY OF ITS RESPECTIVE OWNER(S).

502 N MULLAN RD
SPOKANE VALLEY, WA 99206
PHONE: (509) 362-2214
www.spokanehouseplans.com

SPOKANE
HOUSE PLANS
INC

CONTENTS
MAIN FLOOR PLAN
1988 SQ FT

DRAWN BY: AK
DATE: 03/20/19
SCALE: 1/4"=1'-0"
JOB NO: 1988-R
SHEET

2

OF 5 SHEETS

EVERY EFFORT HAS BEEN MADE TO INSURE THE ACCURACY OF THESE DRAWINGS. HOWEVER, THE CONTRACTOR SHALL CHECK & VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION.

ALL IDEAS, DESIGNS, ARRANGMENTS, DRAWINGS & PLANS SET FORTH ON THIS SHEET ARE THE ORIGINAL WORK, PRODUCT OF, OWNED BY, AND ARE THE PROPERTY OF ITS RESPECTIVE OWNER(S).

502 N MULLAN RD
SPOKANE VALLEY, WA 99206
PHONE: (509) 362-2214
www.spokanehouseplans.com



CONTENTS
FOUNDATION PLAN
BASEMENT

DRAWN BY: AK
DATE: 03/20/19
SCALE: 1/4" = 1'-0"
JOB NO: 1928-R
SHEET 3
OF 5 SHEETS

Fire protection of floors.


R501.3 Floor assemblies shall be provided with a 1/2-inch gypsum wallboard membrane, 5/8-inch wood structural panel membrane, or equivalent on the underside of the floor framing member.

Exceptions:

1. Floor assemblies located directly over a space protected by an automatic sprinkler system in accordance with Section P2904, NFPA13D, or other approved equivalent sprinkler system.
2. Floor assemblies located directly over a crawl space not intended for storage or fuel-fired appliances.
3. Portions of floor assemblies can be unprotected when complying with the following:
 - 3.1. The aggregate area of the unprotected portions shall not exceed 80 square feet per story
 - 3.2. Fire blocking in accordance with Section R302.11.1 shall be installed along the perimeter of the unprotected portion to separate the unprotected portion from the remainder of the floor assembly.
4. Wood floor assemblies using dimension lumber or structural composite lumber equal to or greater than 2-inch by 10-inch (50.8 mm by 254 mm) nominal dimension, or other approved floor assemblies demonstrating equivalent fire performance.

HEADERS

1. All headers supporting roof and ceiling to be (2)-2x10 minimum for max. span of 6'1" with 2 jack studs, unless otherwise noted on plan.
2. Headers supporting roof, ceiling & center bearing floor to be (3)-2x10 minimum for max. span of 6'7" with 2 jack studs, unless otherwise noted on plan.
3. All headers supporting roof, ceiling, and two center bearing floors shall be (3)-2x10 minimum for max. span of 5'7" with 2 jack studs, unless otherwise noted on plan.
4. To reduce sizes for particular openings, refer to plan or to 2015 IRC table R602.7(1).
5. For all interior header sizes & locations, refer to plan.

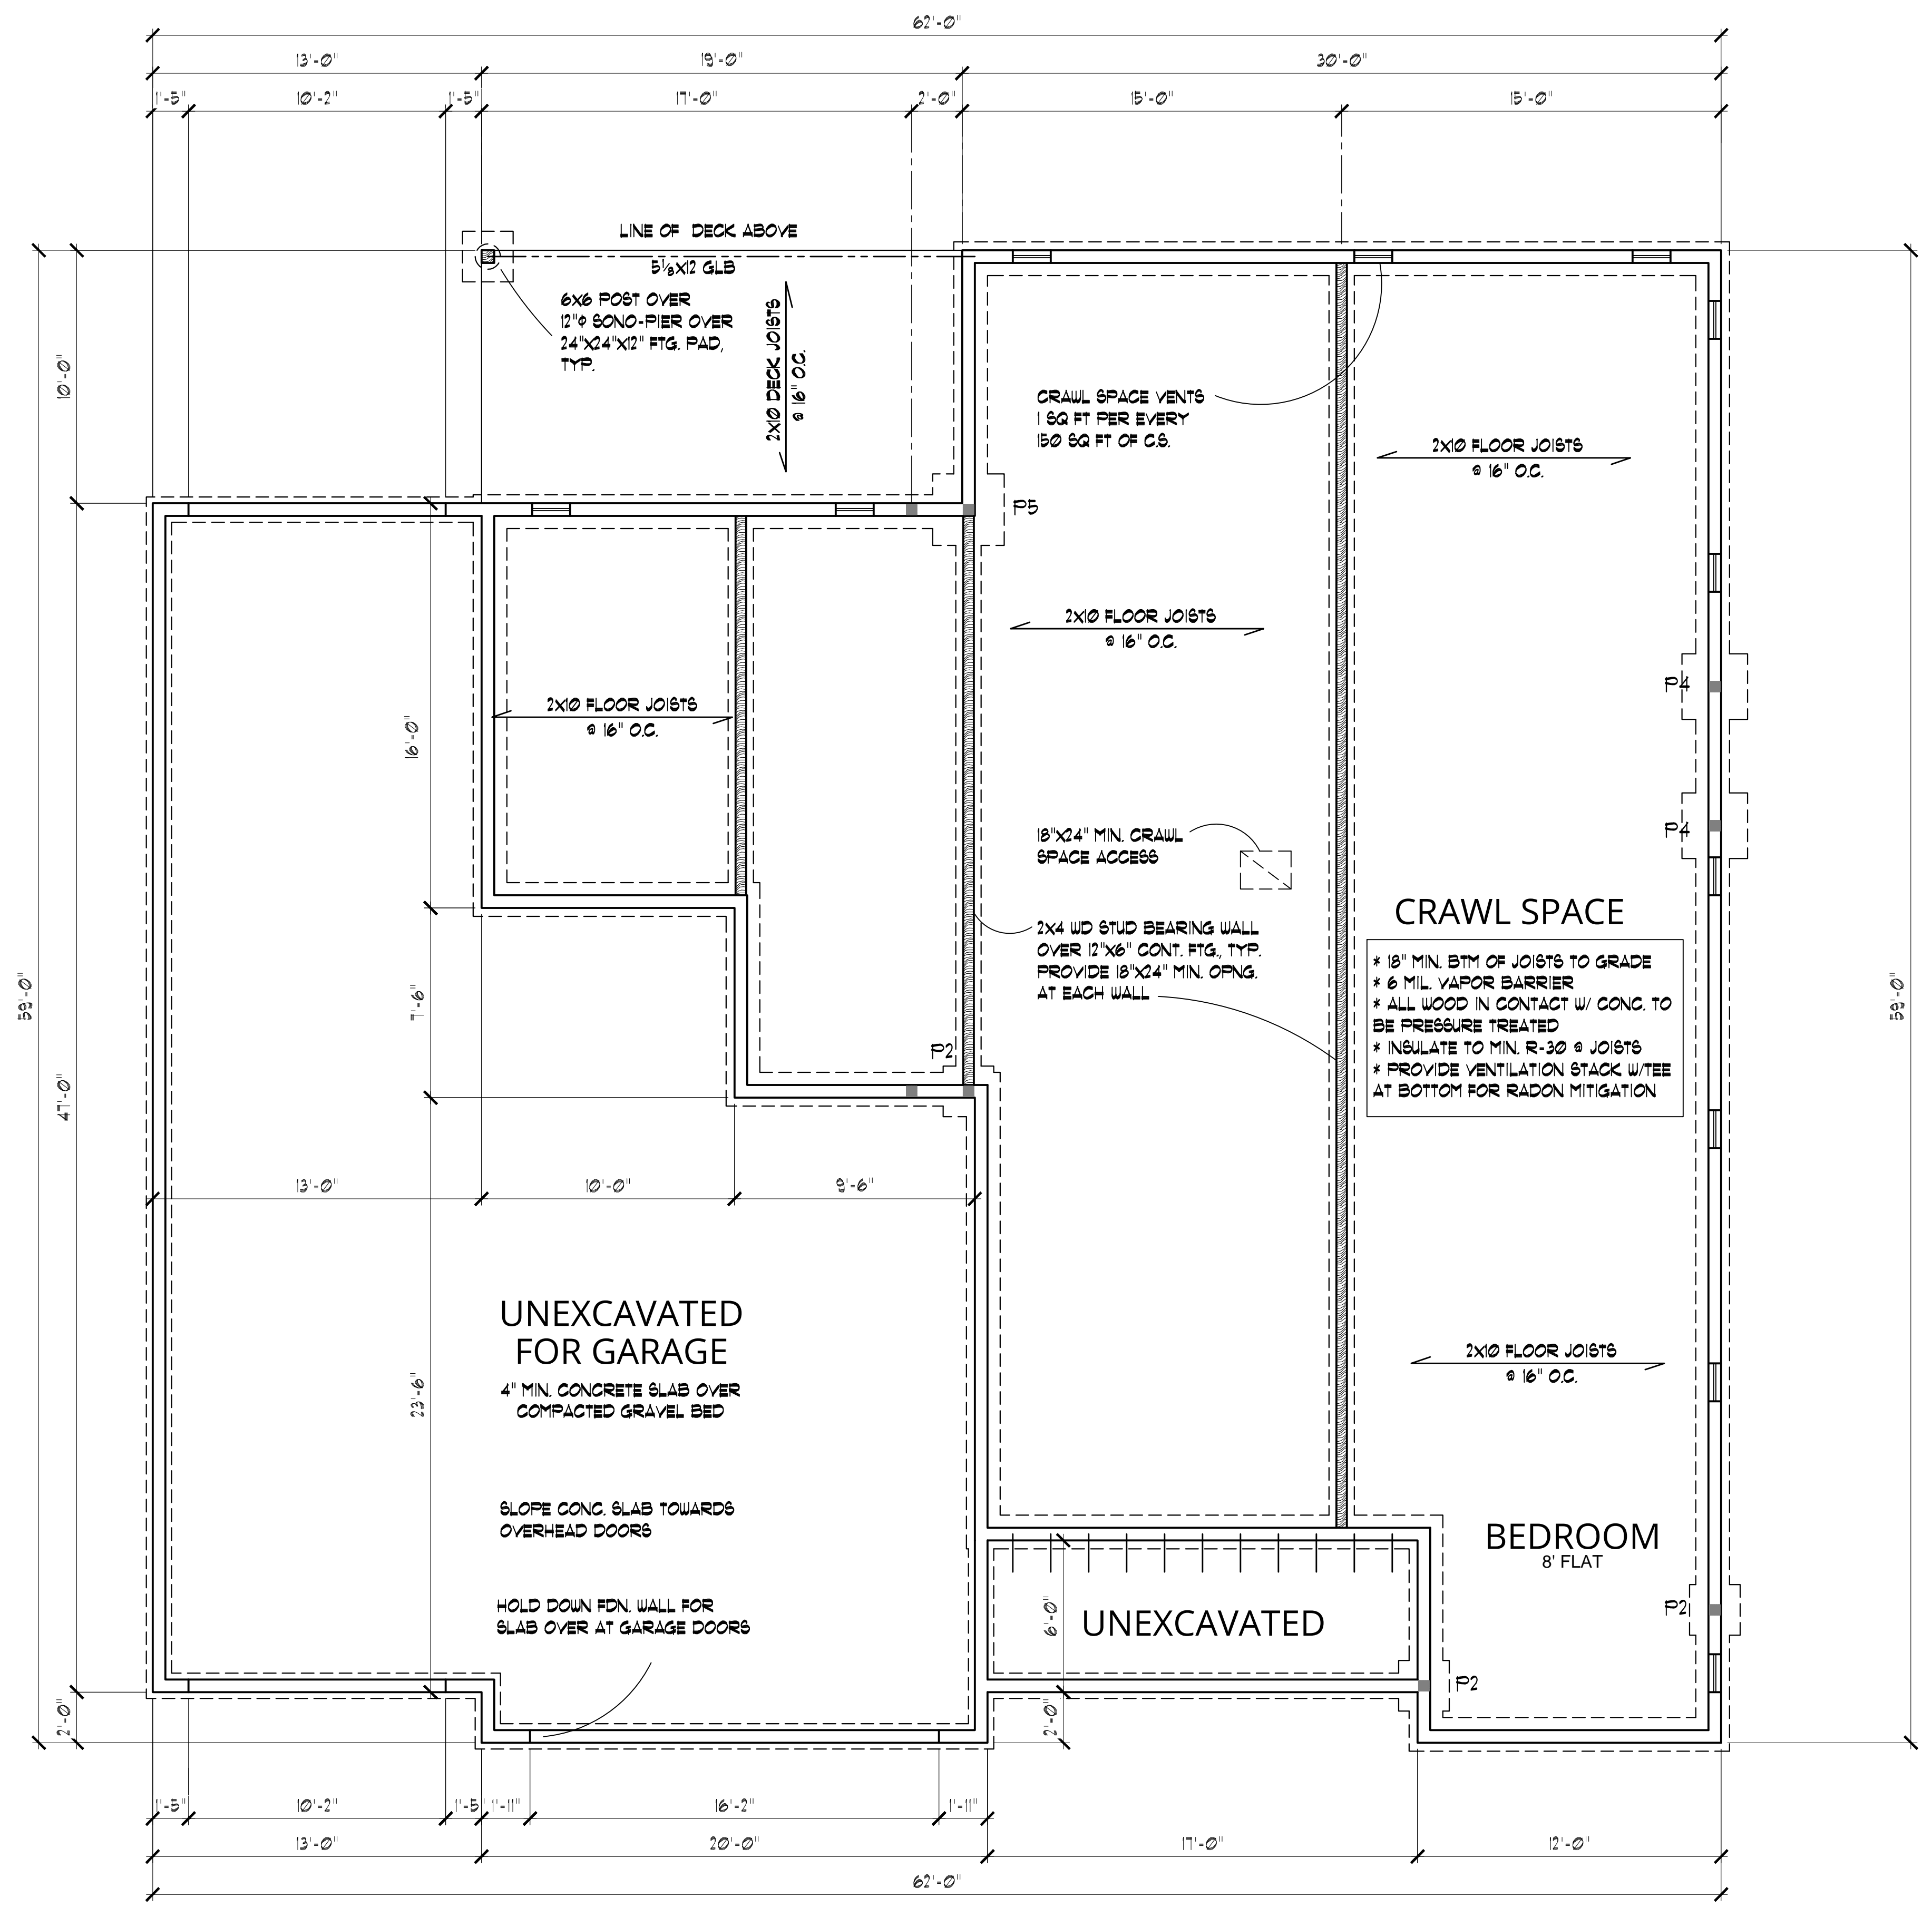

CRAWL SPACE

- * 18" MIN. BTM OF JOISTS TO GRADE
- * 6 MIL. VAPOR BARRIER
- * ALL WOOD IN CONTACT W/ CONG. TO BE PRESSURE TREATED
- * INSULATE TO MIN. R-30 @ JOISTS
- * PROVIDE VENTILATION STACK W/TEE AT BOTTOM FOR RADON MITIGATION

- P1 - 18"x18"x6" FTG PAD UP TO 3,350 LB
- P2 - 24"x24"x9" FTG PAD UP TO 6,250 LB
- P3 - 30"x30"x12" FTG PAD UP TO 9,650 LB
- P4 - 33"x33"x14" FTG PAD UP TO 11,650 LB
- P5 - 36"x36"x15" FTG PAD UP TO 13,850 LB
- P6 - 42"x42"x18" FTG PAD UP TO 18,800 LB

FOUNDATION PLAN
SCALE: 1/4"=1'-0" BASEMENT